

# TEMPERATURE CONTROLLER

## 33 X 72 KR1 model

Quick Guide • ISTR - FKR1ENG03



### DECLARATION OF CONFORMITY AND MANUAL RETRIEVAL

KR1 is a panel mounting, Class II instrument. It has been designed with compliance to the European Directives. All information about the controller use can be found in the Engineering Manual: ISTR-MKR-ENGoX ("x" is the revision). The Declaration of Conformity and the manual of the controller can be downloaded (free of charge) from the web-site: [www.ascontecnologic.com](http://www.ascontecnologic.com)

Once connected to the web-site, search:

**KR1**

then click on **KR1**.

In the lower part of the product page (in any language) is present the download area with links to the documents available for the controller (in the available languages).

#### ⚠ Warning!

- Whenever a failure or a malfunction of the device may cause dangerous situations for persons, things or animals, please remember that the plant must be equipped with additional devices which will guarantee safety.
- We warrant that the products will be free from defects in material and workmanship for 18 months from the date of delivery. Products and components that are subject to wear due to conditions of use, service life and misuse are not covered by this warranty.



viale Indipendenza 56, 27029 - Vigevano (PV) - ITALIA  
Tel.: +39 0381 698 71; Fax: +39 0381 698 730  
Sito internet: [www.ascontecnologic.com](http://www.ascontecnologic.com)  
E-mail: [sales@ascontecnologic.com](mailto:sales@ascontecnologic.com)

### MODEL CODE


The Hardware resources are identified by the following Model Code.

Model: KR1 A B C D E F G H I - 0 0 0 0

Line	KR	1
Optional functions	A	
None		-
Timer	T	
Power Supply	B	
100... 240 Vac (-15... +10%)	H	
24 Vac (-25... +12%) or 24 Vdc (-15... +25%)	L	
Input	C	
TC, PT100, PT1000, mA, mV, V + Digital Input 1	C	
TC, NTC, PTC, mA, mV, V + Digital Input 1	E	
Output OP1	D	
Relay (1 SPDT, 4 A/250 Vac)	R	
VDC for SSR (12 Vdc/20 mA)	O	
Output OP2	E	
None	-	
Relay (1 SPST NO, 4 A/250 Vac)	R	
VDC for SSR VDC for SSR (12 Vdc/20 mA)	O	

Model Code example: KR1-HCRRRD--  
Controller KR1, no timer, 100... 240 Vac, TC/PT100/PT1000/mV/V + Digital Input 1, 3 Relay Outputs, Output 4, TTL, non removable screw type terminals.

### DISPLAY AND KEYS

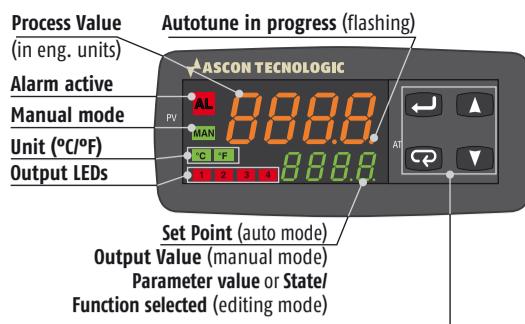


Operator Mode	Editing Mode
Access to: - Operator Commands - Parameters - Configuration	Confirm and go to Next parameter
Access to: - Operator additional information (Output value, running time ...)	Increase the displayed value or select the next element
Access to: - Set Point	Decrease the displayed value or select the previous element
Start the programmed function (Autotune, Auto/Man, Timer ...)	Exit from Operator commands/Parameter setting/Configuration

### DIMENSIONS

Overall dimensions (L x H x D): 78 x 35 x 69.5 mm  
(3.07 x 1.37 x 2.73 in.)  
Panel Cut-out (L x H): 71+0.6 x 29+0.6 mm  
(2.79+0.023 x 1.14+0.023 in.)


### MOUNTING

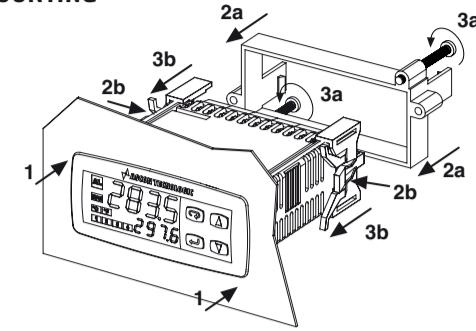

#### ⚠ Attention

The controller can be installed using 2 different types of brackets. Follow the sequence 1, 2a, 3a for the closed version of the bracket, the sequence 1, 2b, 3b for the 2 pieces bracket type.

### ELECTRICAL CONNECTIONS

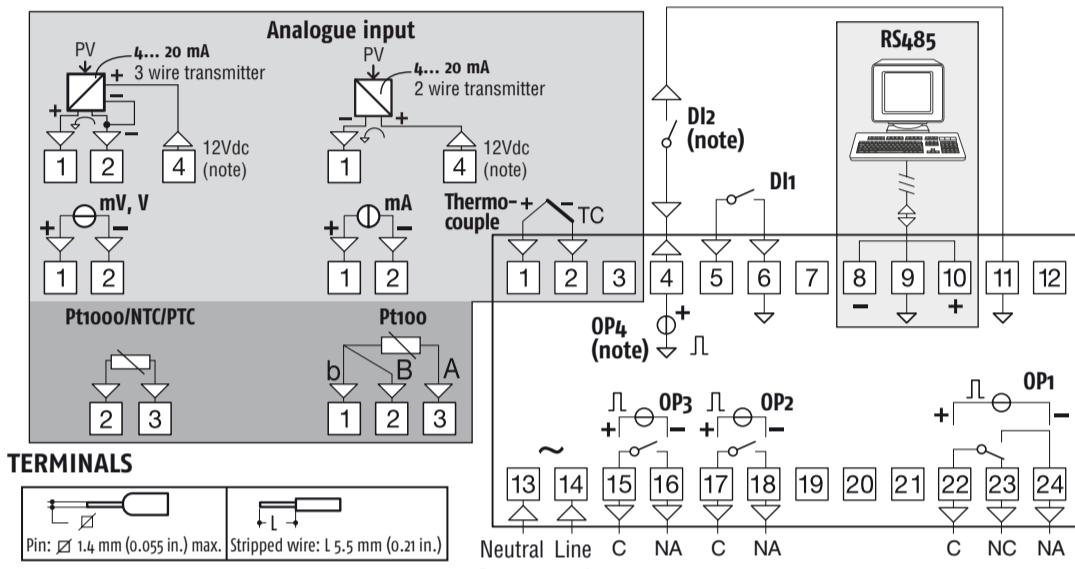

#### TERMINALS




Note: Terminal 4 can be programmed as:

- Digital Input (DI2) connecting a free of voltage contact between terminals 4 and 11;
- 0... 12 V SSR Drive Output (OP4) connecting the load between terminals 4 and 11;
- 12 Vdc (20 mA) transmitter power supply connecting the 2 wire transmitter between terminals 4 and 1; for 3 wire transmitter connect terminal 4 to transmitter power supply input and terminal 1 and 2 to transmitter signal output.

Supply voltage: 100... 240 Vac/  
18... 28 Vac/  
20... 30 Vdc

### HOW TO SET THE CONFIGURATION CODE

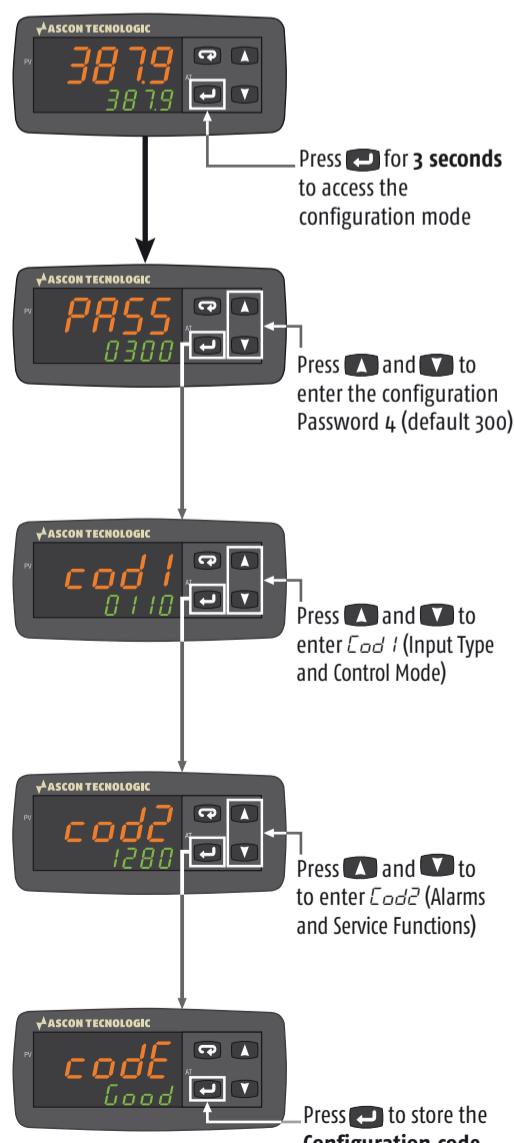

Note: To leave the Configuration session without saving the settings made, press the **MAN** key

### CONFIGURATION CODE


The KR1 can be easily configured by the "Code Configuration" method for the most common requirements, just entering two 4-digit codes: **Cod1** [LMNO] for the Input Type and Control Mode selection and **Cod2** [PQRS] for the Alarms and the Service Functions. For complete controller configuration see the Engineering Manual.

Note: Before starting the configuration code setting, please define and write down **Cod1** and **Cod2** as needed:

User Cod1		Cod1		User Cod2		Cod2	
L	M	N	O	P	Q	R	S
Input Type and Range				L	M	Control mode	
TCJ	-50... +1000°C	0	0	OP1	OP2	OP3	OP4
TC K	-50... +1370°C	0	1	H	Al1	Al2	Al3
TC S	-50... 1760°C	0	2	NU	Al1	Al2	H
TC R	-50... +1760°C	0	3	C	Al1	Al2	0
TCT	-70... +400°C	0	4	NU	Al1	Al2	2
Infrared J	-50... +785°C	0	5	H	C	Al2	Al3
Infrared K	-50... +785°C	0	6	H	Al1	Al2	0
PT100/PTC KTY81-121	-200... +850°C/-55... +150°C	0	7	C	H	Al2	C
PT100/NTC 103-AT2	-200... +850°C/-50... +110°C	0	8	NU	H	Al2	0
Linear 0... 60 mV		0	9	C	Al1	Al2	H
Linear 12... 60 mV		1	0	NU	C	Al2	0
Linear 0... 20 mA (this selection forces Out 4 = TX)		1	1	H	Al1	Al2	1
Linear 4... 20 mA (this selection forces Out 4 = TX)		1	2	NU	Al1	Al2	1
Linear 0... 5 V		1	3	C	Al1	Al2	2
Linear 1... 5 V		1	4	NU	Al1	Al2	C
Linear 0... 10 V		1	5	H	C	Al2	1
Linear 2... 10 V		1	6	H	Al1	Al2	5
TCJ	-58... +1832°F	1	7	C	H	Al2	6
TC K	-58... +2498°F	1	8	NU	H	Al2	7
TC S	-58... 3200°F	1	9	C	Al1	Al2	H
TC R	-58... +3200°F	2	0	NU	C	Al2	0
TCT	-94... +752°F	2	1	H	Al1	Al2	8
Infrared J	-58... +1445°F	2	2	NU	Al1	Al2	C
Infrared K	-58... +1445°F	2	3	C	H	Al2	1
PT100/PTC KTY81-121	-328... +1562°F/-67... +302°F	2	4	NU	H	Al2	7
PT100/NTC 103-AT2	-328... +1562°F/-58... +230°F	2	5	C	Al1	Al2	8


Note: As default, when the alarms are active, only Al1 threshold is available at "Operator Command" level to perform non critical tasks. To protect the Al2 and Al3 thresholds against undesired changes, they are available only at "Parameters list" level (password: 20). For different configurations, see the Engineering Manual.

### ALARM TYPES (Cod2 digits: P, Q, R)




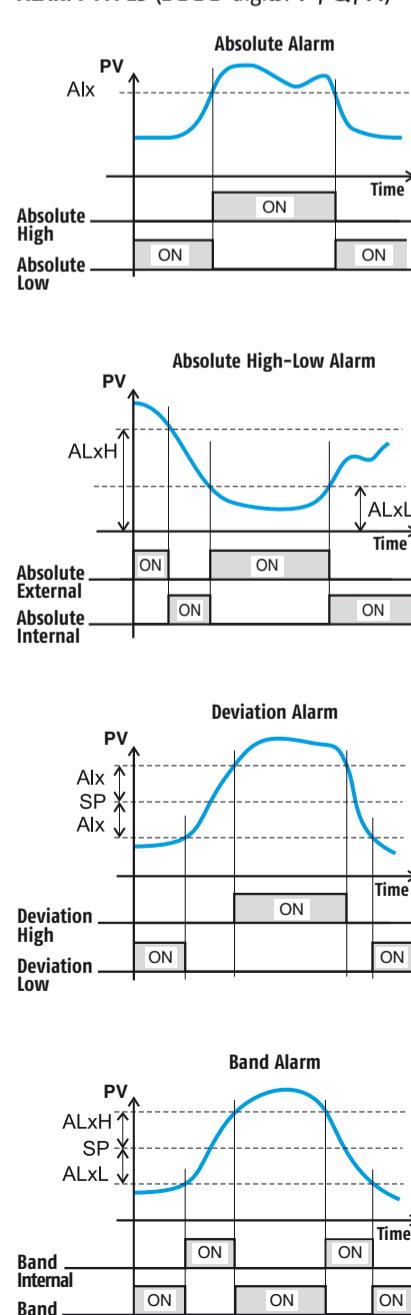


Note: 1. Wattmeter Instantaneous power is continuously computed as multiplication of the Load Voltage, Load Current parameter and the controller output instantaneous value.  
2. Wattmeter power consumption is the estimated hourly energy consumption (using Load Voltage and Load Current parameter values), computed on the previous 15 minutes period. The readout is updated every 15 minutes.  
3. Worked Time counter is continuously increased when the controller is turned ON.

## PARAMETERS SETTING

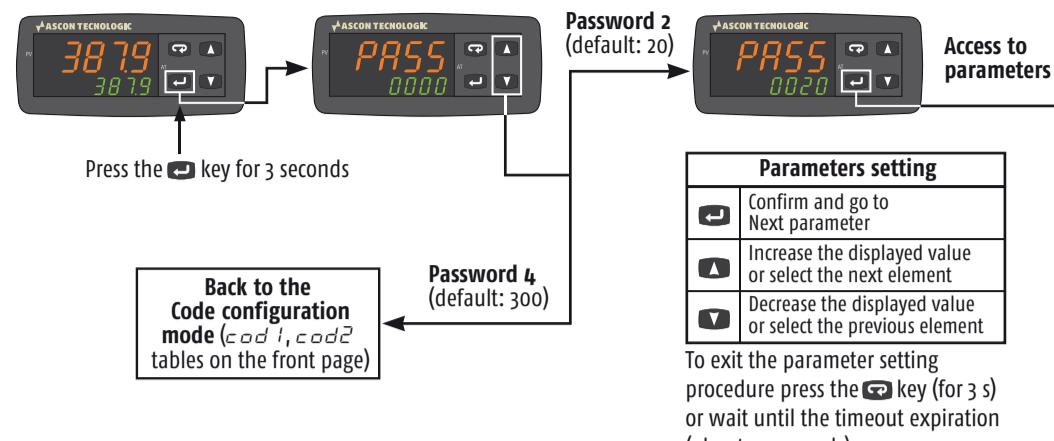

## CONTROLLER OPERATION

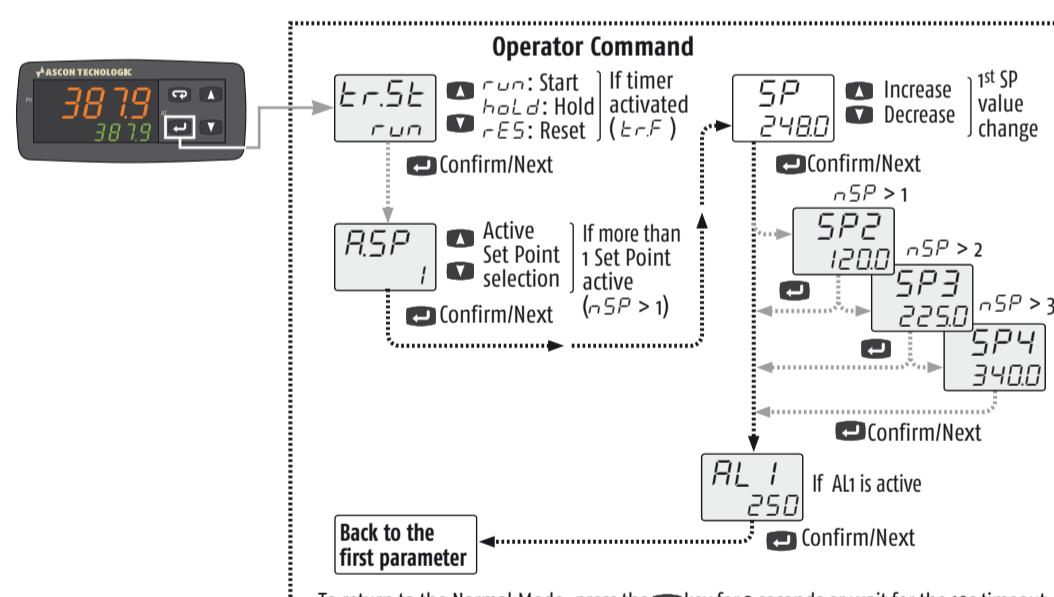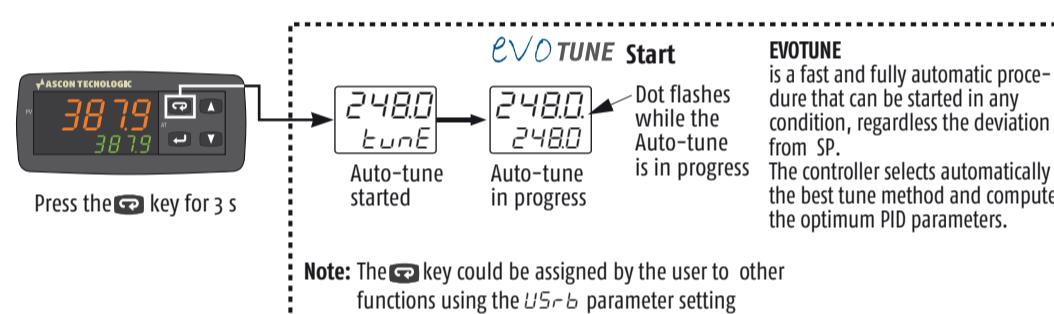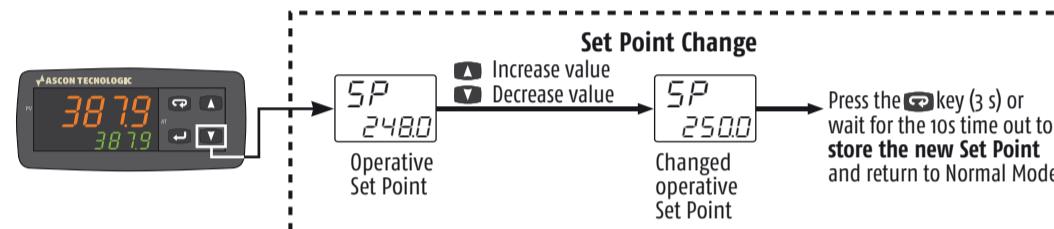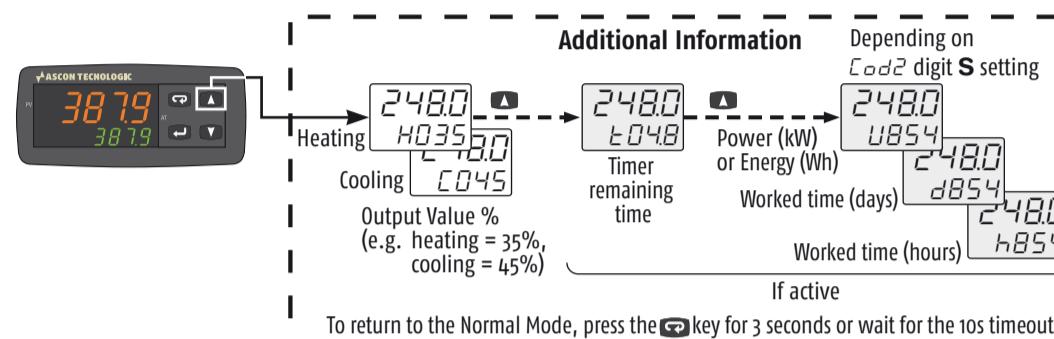

Parameters List (*PASS: 20*) (in gray the parameters related to optional features)


Group	Param.	Description	Range value or selection list elements	Default	User value	Note
Commands	<i>Er.Sr</i>	Timer status				Option
	<i>oPer</i>	Operative Mode Selection	reg = Auto, oplc = Manual, stdy = Standby			
	<i>RSP</i>	Set Point Selection	0 = SP, 1 = SP2, 2 = SP3, 3 = SP4	0 = SP		
	<i>tunE</i>	Start Auto Tune	0 = OFF, 1 = start	0 = OFF		evoTUNE
Control	<i>Pb</i>	Proportional Band	1... 9999 (Engineering Units = E.U.)	20		
	<i>I</i>	Integral Time	0... 10000 s	200		<i>Cod1</i> / Digit <b>N = 1</b>
	<i>d</i>	Derivative Time	0... 1000 s	50		
	<i>HSEt</i>	Hysteresis ON/OFF Control	0... 9999 (E.U.)	1		<i>Cod1</i> / Digit <b>N = 0</b>
	<i>tch</i>	Heating output cycle time	0.1... 130 s	20.0		<i>Cod1</i> / Digit <b>N = 1</b>
	<i>rco</i>	Relative Cooling Gain	0.01... 99.99	1.00		<i>Cod1</i> / Digit <b>N = 1</b> <i>Cod1</i> / Digit <b>O &gt; 4</b>
	<i>tcc</i>	Cooling output cycle time	0.1... 130 s	20.0		<i>Cod1</i> / Digit <b>N = 1</b> <i>Cod1</i> / Digit <b>O &gt; 1</b>
Set Point	<i>SP</i>	Set Point 1	-1999... +9999 (E.U.)			
	<i>SP2</i>	Set Point 2				If <i>nSP &gt; 1</i>
	<i>SP3</i>	Set Point 3				If <i>nSP &gt; 2</i>
	<i>SP4</i>	Set Point 4				If <i>nSP &gt; 3</i>
Alarms	<i>SPLL</i>	Set Point min. Value	-1999... SPHL (E.U.)			
	<i>SPHL</i>	Set Point max. Value	SPHL... 9999 (E.U.)			
	<i>nSP</i>	No. of Set Points	1... 4	1		
	<i>RL 1</i>	Alarm 1 threshold	AL1L... AL1H			
	<i>RL 1L</i>	Alarm 1 low threshold/Low limit	-1999... +9999 (E.U.)	-1999		If digit <b>P</b> of <i>Cod2</i> is > 1
	<i>RL 1H</i>	Alarm 1 high threshold/High limit	9999			
	<i>HRL 1</i>	AL1 hysteresis	1... 9999 (E.U.)	1		
Soft Start	<i>RL 2</i>	Alarm 2 threshold	AL2L... AL2H			
	<i>RL 2L</i>	Alarm 2 low threshold/Low limit	-1999... +9999 (E.U.)	-1999		If digit <b>Q</b> of <i>Cod2</i> is > 1
	<i>RL 2H</i>	Alarm 2 high threshold/High limit	9999			
	<i>HRL 2</i>	AL2 hysteresis	1... 9999 (E.U.)	1		
Input	<i>RL 3</i>	Alarm 3 threshold	AL3L... AL3H			
	<i>RL 3L</i>	Alarm 3 low threshold/Low limit	-1999... +9999 (E.U.)	-1999		If digit <b>R</b> of <i>Cod2</i> is > 1
	<i>RL 3H</i>	Alarm 3 high threshold/High limit	9999			
	<i>HRL 3</i>	AL3 hysteresis	1... 9999 (E.U.)	1		
Timer	<i>StP</i>	Soft Start Output value	-100... 100%	0		
	<i>Stt</i>	Soft Start Time	0.00... 8.00 (hh:mm)	0		
	<i>Sc</i>	Low Scale readout	-1999... 9999	-1999		For linear Input types only
	<i>FSc</i>	High Scale readout	-1999... 9999	9999		
	<i>dP</i>	Number of decimals	0... 3 (linear inputs); 0... 1 (other inputs)	0		
	<i>F_L</i>	Measured value Digital filter	OFF; 0.1... 20.0 s	0 = OFF		
	<i>Er.F</i>	Timer Type	nonE = Timer not used i.d.A = Delayed ON at start command i.u.p.d = Activation ON at Power ON i.d.d = At start command i.P.L = Asymmetrical oscillator, start in OFF i.L.P = Asymmetrical oscillator, start in ON	none		Timer management (Start, Stop, Reset) can be done using the <i>Er.Sr</i> command or the  key (if programmed) or by the DI1/DI2 digital inputs (if programmed).
	<i>Er.u</i>	Timer Units	0 = hh:mm 1 = mm:ss 2 = ss.s	1 = mm:ss		
I/O	<i>Er.t1</i>	Time 1	00.01... 995.9	1.00		
	<i>Er.t2</i>	Time 2	00.00... 995.9	1.00		
Digital Inputs	<i>IO4F</i>	I/O 4 Function	ON = Transmitter Power Supply OUT4 = SSR out D12C = Dig. In. from contact D12U = 24 VDC Digital Input	ON		
	<i>d1F1</i>	Digital Input 1 Function	0... 21	0		See the DI1, DI2 functions table
	<i>d1F2</i>	Digital Input 2 Function	0... 21	0		
Display	<i>uSrb</i>	Key  Function	nonE, tunE, oplo, aac, asi, chsp, st.bv, str.t	tunE		See the  Key function table
	<i>dCL</i>	Colour of the Process Value display	0 = Change 1 = Red 2 = Green 3 = Orange	2		If Change, the colour is green if PV differs from SP less than <i>RdE</i> , red if higher than <i>RdE</i> and orange if is lower than <i>RdE</i>
Serial communications	<i>RdE</i>	Display change color threshold (when <i>dCL</i> = 0)	0 (OFF)... 9999 (e.u.)			
	<i>dSL</i>	Display Power OFF time (mm:ss)	0FF (display ON) 0... 99.59	0FF		
Wattmeter	<i>addr</i>	Instrument Address	1... 254	1		
	<i>bRud</i>	Baud rate	1200, 2400, 9600 baud, 19.2, 38.4 kbaud	9600		Modbus RTU slave protocol
Password	<i>UoLc</i>	Load Voltage	1... 999 (V)	230		
	<i>cur</i>	Load Current	1... 9999 (A)			If digit <b>S</b> of <i>Cod2</i> is > 1
	<i>PR54</i>	Configuration access Password	0... 999	300		
	<i>PR52</i>	Parameters access Password	0... 999	20		

**Note:** To access all the instrument features, please see the "Complete configuration procedure" in the "Engineering Manual". Complete Configuration and Parameter setting can be easily uploaded from the controller and downloaded to other controllers using the: Configuration Key and Communication Adapter model: A-01.


## FUNCTION SELECTION

Timer Types (selected by *Er.F* (option))


*dR* Delayed ON at Start command

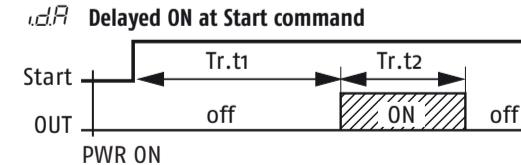


*wPd* Delayed ON at Power ON

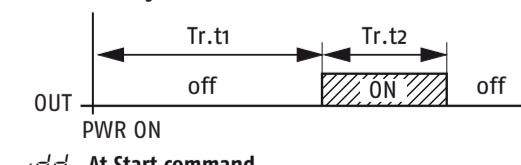


*dd* At Start command

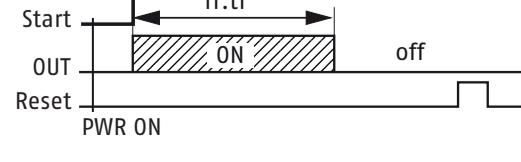

*L.P* Asymmetrical oscillator with start in OFF

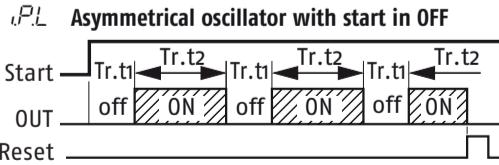

*L.P* Asymmetrical oscillator with start in ON

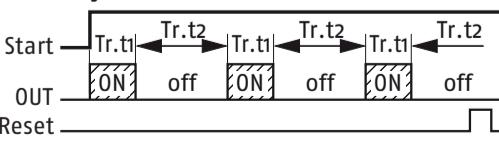

## *d1F* - Digital Inputs DI1 and DI2 Functions

Code displayed	Description
0	Disabled (OFF) (default)
1	Alarm Reset
2	Alarm Acknowledge (ACK)
3	Hold of the measured value
4	Stand by mode
5	Manual Mode
6	Heat with "SP" and Cool with "SP2"
7	Timer Run/Hold/Reset [on transition]
8	Timer Run [on transition]
9	Timer Reset [on transition]
10	Timer Run/Hold
11	Timer Run/Reset
12	Timer Run/Reset with lock at the end of the time count
18	Sequential Set Point selection [on transition]
19	SP/SP2 selection
20	Binary coding for Set Point selection on DI1 and DI2 (00 = SP, 01 = SP2, 10 = SP3, 11 = SP4)
21	Digital inputs in parallel to  and  keys (DI1 = , DI2 = )

## *uSrb* Key Function

Code displayed	Description




<tbl\_r cells="2" ix="4" maxcspan="1" maxrspan="1" usedcols

# X-ON Electronics

Largest Supplier of Electrical and Electronic Components

***Click to view similar products for Temperature Sensor Modules category:***

***Click to view products by Ascon manufacturer:***

Other Similar products are found below :

[HPP809A031](#) [MBT 3560-0000-0050-10-110](#) [MBT 3560-0000-0100-10-110](#) [MBT 3560-0001-0050-10-120](#) [MBT 3560-0001-0100-10-120](#)  
[TCN4L-22R](#) [TX4H-14R](#) [TX4H-24R](#) [TX4H-A4R](#) [TX4H-B4R](#) [TX4L-14R](#) [TX4L-A4R](#) [TX4L-B4R](#) [TX4M-14R](#) [TX4M-24R](#) [TX4M-A4R](#)  
[TX4M-B4R](#) [QP99](#) [CP-02](#) [CP82](#) [CP99](#) [R38-LAOO](#) [R38-LARR](#) [72-11304023-0150.0050](#) [72-11304027-0150.0050](#) [72-23304003-](#)  
[0150.0050.GGP](#) [72-23904001-0300.0040.TM](#) [72-34904001-0300.0040.TM](#) [TEM 73 A](#) [AT403-414-1000](#) [AT403-614-1000](#) [AT-503-1141-000](#)  
[AT-503-1161-000](#) [AT-503-6140-000](#) [AT-603-1141-000](#) [AT603-414-1000](#) [AT-903-1161-000](#) [ATR121-AD](#) [ATR121-B](#) [TPMC-5](#) [TPMC-8W](#)  
[K39-HCRR](#) [K39T-HCRR](#) [K49-HCRR](#) [K49P-HCRR](#) [K85-HERR](#) [KR1-LCRR-D](#) [LHI874](#) [LHI944](#) [LHI968](#)