

# Temperature / Humidity Sensor



## THD Series PRODUCT MANUAL

**For your safety, read and follow the considerations written in the instruction manual, other manuals and Autonics website.**

The specifications, dimensions, etc. are subject to change without notice for product improvement. Some models may be discontinued without notice.

### Features

- Compact design
- Built-in high accuracy temperature / humidity sensor
- 7 segment LED display (THD-DD / THD-WD)
- Various output options: DC4-20mA, 1-5 VDC, RS485 (Modbus RTU)
- Wide measureable range of temperature / humidity: -19.9 to 60.0 °C / 0.0 to 99.9 %RH
- Communication speed: 115200 bps

### Safety Considerations

- Observe all 'Safety Considerations' for safe and proper operation to avoid hazards.
- **⚠** symbol indicates caution due to special circumstances in which hazards may occur.

#### **⚠ Warning** Failure to follow instructions may result in serious injury or death.

01. **Fail-safe device must be installed when using the unit with machinery that may cause serious injury or substantial economic loss.(e.g. nuclear power control, medical equipment, ships, vehicles, railways, aircraft, combustion apparatus, safety equipment, crime/disaster prevention devices, etc.)**  
Failure to follow this instruction may result in personal injury, economic loss or fire.
02. **Do not use the unit in the place where flammable/explosive/corrosive gas, high humidity, direct sunlight, radiant heat, vibration, impact or salinity may be present.**  
Failure to follow this instruction may result in explosion or fire.
03. **Do not connect, repair, or inspect the unit while connected to a power source.**  
Failure to follow this instruction may result in fire.
04. **Check 'Connections' before wiring.**  
Failure to follow this instruction may result in fire.
05. **Do not disassemble or modify the unit.**  
Failure to follow this instruction may result in fire.

#### **⚠ Caution** Failure to follow instructions may result in injury or product damage.

01. **Use the unit within the rated specifications.**  
Failure to follow this instruction may result in fire or shortening the life cycle of the product.
02. **Use a dry cloth to clean the unit, and do not use water or organic solvent.**  
Failure to follow this instruction may result in fire.
03. **Keep the product away from metal chip, dust, and wire residue which flow into the unit.**  
Failure to follow this instruction may result in fire or product damage.

### Cautions during Use

- Follow instructions in 'Cautions during Use'. Otherwise, it may cause unexpected accidents.
- Keep away from high voltage lines or power lines to prevent inductive noise. In case installing power line and input signal line closely, use line filter or varistor at power line and shielded wire at input signal line. Do not use near the equipment which generates strong magnetic force or high frequency noise.
- Install a power switch or circuit breaker in the easily accessible place for supplying or disconnecting the power.
- 24VDC: power supply should be insulated and limited voltage/current or Class 2, SELV power supply device.
- Do not overlapping communication line and power line. Use twisted pair wire for communication line and connect ferrite bead at each end of line to reduce the effect of external noise.
- Do not touch THD-W/D sensor part at the bottom of the sensor pole by hands. It may cause malfunction.
- THD-R must be installed on the wall. It may cause malfunction.
- Make a required space around the unit for radiation of heat. For accurate temperature measurement, warm up the unit over 20 min after turning on the power.
- Make sure that power supply voltage reaches to the rated voltage within 2 sec after supplying power.

- Do not wire to terminals which are not used.
- This unit may be used in the following environments.
  - Indoors (in the environment condition rated in 'Specifications')
  - Altitude max. 2,000 m
  - Pollution degree 2
  - Installation category II

## Ordering Information

This is only for reference.  
For selecting the specified model, follow the Autonics website.

**THD - ① ② ③ - ④**

### ① Mounting type

R: Room type (for indoor)  
D: Duct mounting type  
W: Wall mounting type

### ② Display

No mark: Non-display type  
D: Display type

### ③ Sensor pole length

No mark: Built-in type  
1: 100 mm  
2: 200 mm

### ④ Output

	Temperature	Humidity
<b>C</b>	Current output	
<b>V</b>	Voltage output	
<b>T</b>	RS485 communication output	
<b>PT</b>	DPT100Ω resistance value	-
<b>PT/C</b>	DPT100Ω resistance value	Current output

## Product Components

- Product
- Instruction manual
- Bracket (THD-W / D model)

## Software

Download the installation file and the manuals from the Autonics website.



### ■ DAQMaster

DAQMaster is comprehensive device management program. It is available for parameter setting, monitoring.


## Dimensions

- Unit: mm, For the detailed drawings, follow the Autonics website.


### ■ THD-R



### ■ THD-D

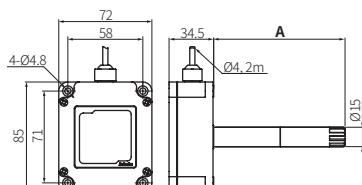


### ■ THD-W

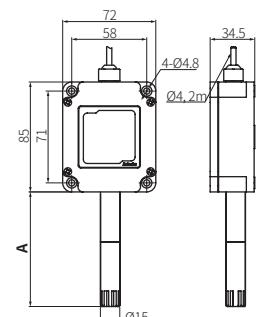

Model	Sensor pole length (A)
THD-□1-□	100 mm
THD-□2-□	200 mm


### ■ Bracket




## Connections

- Check the terminal connection diagram and be careful with connecting the power.


### ■ THD-R

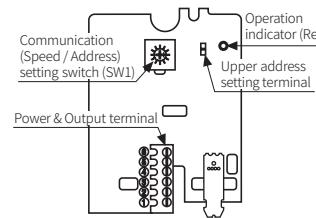


### ■ THD-D / THD-W




### THD-□-C

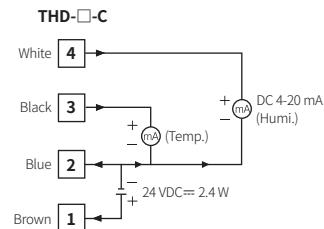


### THD-□-PT




### THD-□-V

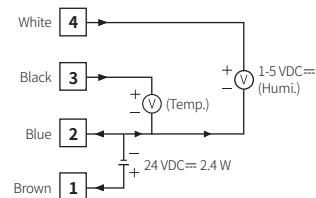

### THD-□-PT/C

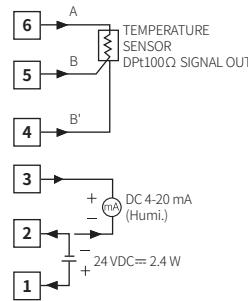

### THD-□-T

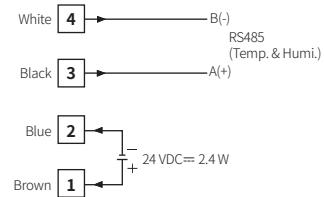


## Case Detachment

- When setting communication, turn off the power, remove the case cover, and operate the communication setting switch to set the communication address and speed. Refer to 'RS485 Communication' for the details.


### ■ THD-R

- Unfasten the bolt on the bottom of the product, separate the case from it.

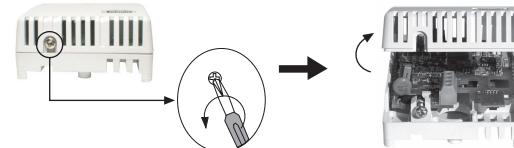

### ■ THD-D / THD-W

- Unfasten 4 bolts on the top of the product, separate the case cover from it.

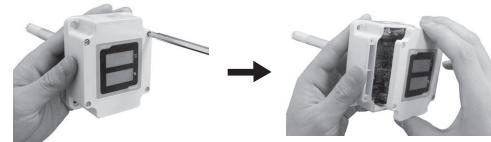

## Errors

Display part (Temp. / Humi)	Description	Troubleshooting
Err	Displays when malfunction of sensor module.	Contact our A/S center.
HHH / Max. value	Displays when PV is higher than measuring range.	When input is within the measuring range, this display disappears.
LLL / Min. value	Displays when PV is lower than measuring range.	

## Specifications

Model	THD-R-PT						
Sensor type	Temperature sensor						
Display type	Non-display type						
Temp. measuring range	-19.9 to 60.0 °C						
Temp. accuracy	≤ ±0.8 °C						
Temp. output	DPt100Ω resistance value (TCR: 3850 ppm/°C)						
Protection structure	IP10 (IEC standards)						
Ambient temperature	-20 to 60 °C, Storage: -20 to 60 °C (rated at no freezing or condensation)						
Approval	CE    						
Model	THD-R-PT/C	THD-R-C THD-R-V THD-R-T	THD-D□-□ THD-W□-□	THD-DD□-□ THD-WD□-□			
Power supply	24 VDC ± 10 %						
Power consumption	≤ 2.4W						
Sensor type	Temperature/Humidity Sensor						
Sensor response time	10 sec						
Display type	Non-display type	7 seg. LED display					
Display digit	-	Each 3 digits for temp. / humi.					
Temp. measuring range	-19.9 to 60.0 °C						
Humi. measuring range	0.0 to 99.9 %RH (THD-R is required to attend for using over 90 %RH)						
Temp. accuracy	± 1.0 °C (at room temp.)						
Humi. accuracy	± 3 %RH (30 to 70 %RH, at room temp.) ± 4 %RH (10 to 90 %RH)	Typ. ±2 %RH (10 to 90 %RH, at room temp.) ≤ ± 2.5 %RH					
Temp. output	DPt100Ω resistance value (TCR: 3850 ppm/°C)	DC 4-20 mA (allowable impedance: ≤ 600 Ω), 1-5 VDC, RS485 Communication (Modbus RTU)					
Humi. output	DC 4-20 mA (allowable impedance: ≤ 600 Ω)						
Resolution	1/1000						
Sampling period	0.5 sec						
Insulation resistance	≥ 100 MΩ (500 VDC megger)						
Dielectric strength	Between the charging part and the case: 500 VAC ~ 50/60 Hz for 1 min						
Noise immunity	±0.3 kV the square wave noise (pulse width: 1 μs) by the noise simulator						
Vibration	0.75 mm amplitude at frequency of 10 to 55 Hz in each X, Y, Z direction for 1 hour						
Vibration (Malfunction)	0.5 mm amplitude at frequency of 10 to 55Hz in each X, Y, Z direction for 1 hour						
Shock	300 m/s <sup>2</sup> (≈ 30 G) in each X, Y, Z direction for 3 times						
Shock (Malfunction)	100 m/s <sup>2</sup> (≈ 10 G) in each X, Y, Z direction for 3 times						
Protection structure	IP10 (IEC standards)	IP65 (except sensor part, IEC standards)					
Ambient temperature	-20 to 60 °C, Storage: -20 to 60 °C (rated at no freezing or condensation)						
Cable spec.	-	Ø4 mm, 4-wire, length: 2 m					
Wire spec.	-	AWG22 (0.08 mm, 60-wire), Insulator diameter: Ø1.25 mm					
Approval	CE     (only for THD-□-T model) 						

## Communication Interface

### RS485

Comm. protocol	Modbus RTU
Application standard	Compliance with EIA RS485
Max. Connection	31 units (address: 01 to 31)
Synchronous method	Asynchronous
Comm. method	2-wire half duplex
Comm. distance	< 800 m
Comm. speed	1200 to 115200 bps (selectable)
Start bit	1 bit (fixed)
Data bit	8 bit (fixed)
Parity bit	None (fixed)
Stop bit	1 bit (fixed)

- It is not allowed to change parameter related to THD communication under the communication with high order system.  
(THD and upper system are available to change the address at communication status.)
- Match the parameter of THD communication to be same as the high order system.
- It is not allowed to set overlapping communication address at the same communication line. Use twisted pair wire which is appropriate communication cable for RS485 communication.

## Functions

### Current output

- It transmits current temperature and humidity to other devices (PC, recorder, etc.) and outputs DC 4-20 mA.
- The temperature and humidity output are separated and the resolution is divisible by 1,000.

Temperature	Humidity	Voltage Output
-19.9 °C	0.0 %RH	DC 4 mA
60.0 °C	99.9 %RH	DC 20 mA

### Voltage output

- It transmits current temperature and humidity to other devices (PC, recorder, etc.) and outputs 1-5 VDC.
- The temperature and humidity output are separated and the resolution is divisible by 1,000.

Temperature	Humidity	Voltage Output
-19.9 °C	0.0 %RH	1 VDC
60.0 °C	99.9 %RH	5 VDC

### DPt100Ω resistance value output


- It transmits current temperature to other devices (recorder, thermometer, etc.).
- Temperature coefficient (TCR) = 3850 ppm/°C

Temperature	Resistance value output
0.0 °C	100 Ω
50.0 °C	119.40 Ω

## RS485 Communication

### Ordering of communication control

- The communication method is Modbus RTU.
- After 2.0 sec supplying the power into master system, it is able to start communication.
- The initial communication is started by master system. When a command comes out from the master system, THD will respond.

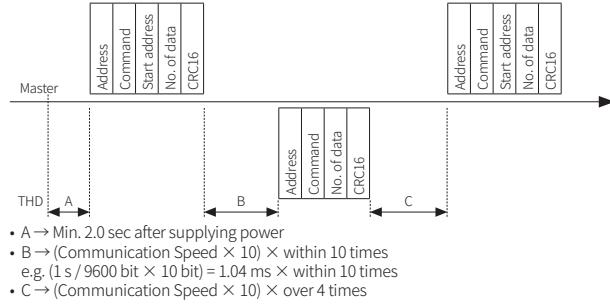

### Communication speed setting

- Turn off the power of the unit.
- Set SW1 to 0 and supply the power.
- Operation indicator LED is flashing.
- Set a communication speed after choosing SW1 within the range 1 to 8, and hold it for 3 sec.
- After 3 sec and operation indicator is ON, turn OFF the power.

SW1	Comm. speed (bps)
1	1200
2	2400
3	4800
4	9600 (factory default)
5	19200
6	38400
7	57600
8	115200

### Communication address setting

- Set upper address setting terminal and setting switch (SW1) to the desired address and supply the power.
- The communication address is changed automatically.

Address	Upper address setting terminal	SW1	Adress	Upper address setting terminal	SW1
01	OPEN	1 (factory default)	16	SHORT	0
02	OPEN	2	17	SHORT	1
03	OPEN	3	18	SHORT	2
04	OPEN	4	19	SHORT	3
05	OPEN	5	20	SHORT	4
06	OPEN	6	21	SHORT	5
07	OPEN	7	22	SHORT	6
08	OPEN	8	23	SHORT	7
09	OPEN	9	24	SHORT	8
10	OPEN	A	25	SHORT	9
11	OPEN	B	26	SHORT	A
12	OPEN	C	27	SHORT	B
13	OPEN	D	28	SHORT	C
14	OPEN	E	29	SHORT	D
15	OPEN	F	30	SHORT	E
-			31	SHORT	F

### Modbus mapping table

Address	Description	Note
300001 (0000)	Temperature value	Value × 0.01
300002 (0001)	Humidity value	Value × 0.01

# X-ON Electronics

Largest Supplier of Electrical and Electronic Components

***Click to view similar products for [Board Mount Temperature Sensors](#) category:***

***Click to view products by [Autonics](#) manufacturer:***

Other Similar products are found below :

[66F115](#) [389049M9527](#) [MIKROE-912](#) [ADM1023ARQZ-REEL](#) [ADM1032ARMZ-1RL](#) [ADT7481ARMZ-REEL](#) [ADT7463ARQZ-REEL](#)  
[NCT375MNR2G](#) [NCT80DBR2G](#) [NVT211CMTR2G](#) [GX112XA](#) [GX112XT](#) [GX36](#) [GXTR304Q](#) [GXHTV3C](#) [GXTS02S](#) [HT18B20ARTZ](#)  
[TMP114AIYMTR](#) [DS18B20A30](#) [DS18B20A20](#) [LM35CZ/LFT1](#) [GXTS04D](#) [MLX90640ESF-BAA-000-TU](#) [GXT310T0](#) [GXT310W0](#)  
[GX112XTE](#) [TMP119AIYBGR](#) [TMP1826NGRR](#) [TMP103AYFFR\(UMW\)](#) [GZT263](#) [DS18B20\(XBLW\)](#) [HX18B20-T](#) [THD-R-T](#)  
[CHT20MEMS](#) [GXHT30C](#) [MLX90641ESF-BCB-000-TU](#) [DS18B20+JSM](#) [NST235-DSCR](#) [SYP10-755](#) [SYP20-CO2-B](#) [DS18B20U-MS](#)  
[LMT87DCKR\(UMW\)](#) [DS18B20T\(XBLW\)](#) [SL-FW-TRS-5.5D1](#) [DS18B20A50](#) [SYP10-A6LF55](#) [SYP10-A68](#) [SYS03](#) [SYS05](#) [SYP10-AL65](#)